

13th December 2016

Our reference: 132739.L03

Your reference: 16/02377/FUL

Ms Susanna Hope
Drainage Engineer
Hart District Council
Civic Offices
Harlington Way
Fleet
Hampshire
GU51 4AE

RESPONSE TO COMMENTS RE: DEMOLITION OF THE EXISTING STABLE BUILDING, ARENA, FLOODLIGHTS AND HARDSTANDING, AND THE ERECTION OF 30 RESIDENTIAL DWELLINGS, WITH ASSOCIATED ACCESS, LANDSCAPING, AND CAR PARKING ARRANGEMENTS.

Dear Susanna,

We write with respect to your comments (dated 18th October 2016) regarding the site at Broden Stables in Crondall, specifically following the receipt of borehole records from the Environment Agency (EA). This letter addresses points raised within your comments, including groundwater flooding issues, infiltration and surface water discharge rates, in the context of this recently received data, as well as comments received from Hampshire County Council (HCC) as the Lead Local Flood Authority (LLFA).

Groundwater

Comments were made on the planning application based on EA groundwater data from 2014 (specifically a map, attached in **Appendix A**) that was assumed to be historic in nature. This information was not made available during the pre-application process, and as such, further information was subsequently requested from the EA. The EA have confirmed that they do not have access to the metadata used to create this mapping, therefore it is not considered suitable to solely assess the site based on this information. The EA have instead supplied historic borehole records within the site vicinity (see **Appendix B**). Analysis of this data indicates that groundwater flooding is highly unlikely to occur in the area indicated on the EA mapping. In addition, the area in which groundwater flooding is indicated (the southern corner of the site) is at the high point within the site, with ground levels sloping down to towards the northeast, north, northwest, west and southwest. It is therefore not considered necessary to move houses outside of this area, given its elevation and the EA borehole data that indicates the area is at the lowest risk of flooding from this source.

Lower sections of the site to the north are unlikely to experience groundwater flooding, given the site elevation above Redlands Lane. If groundwater levels were to be high in this area of the site, groundwater would likely rise to the surface within Redlands Lane, before appearing within the site. For



groundwater flooding to affect this area of the site, approximately 1m of flood water would have to be present within Redlands Lane as this represents the minimum difference in levels between the site and Redlands Lane.

Based on the request for further information within your comments for groundwater levels monitored through a winter period and/or mitigation measures to prevent internal flooding and impact on below ground infrastructure, it is not considered appropriate in this instance undertake long-term groundwater monitoring. It is therefore recommended that finished floor levels of residential dwellings are raised by a minimum of 150mm in respect of immediate surrounding ground levels to prevent the ingress of any groundwater flows into properties. With respect to minimising the impact on below ground infrastructure, it is recommended that best practice is followed to ensure that foul and surface water drainage are sealed systems in order to prevent the ingress of groundwater into the drainage systems. Non-return valves could also be fitted to prevent flooding within properties. It is also recommended that drainage networks be laid as shallow as possible to reduce the potential for groundwater ingress.

In relation to your comment regarding residents' safety during a groundwater flood event, any groundwater flow on site would be shallow (based on the on-site gradient) and would likely flow to the north and follow the road network off-site to the north and northeast. Appropriate signage should be provided within the basin areas to warn of possible water depths during storm events. Further measures could include fencing the area off and providing suitable recovery equipment, such as a lifebuoy ring.

Infiltration

Within your comments, a groundwater strike of 1.6m below ground level (mBGL) is stated; however, the FRA references groundwater seepage. Groundwater seepage could be expected at this depth, and is not an accurate indicator of a water table at this depth. In addition, for a water table to be found at this depth in this location there would likely be permanent baseflow within the drainage ditches within Redlands Lane – something not observed during site walkovers or reported during our pre-application discussions with consultees.

Surface water discharge rate

We acknowledge your comments on the surface water discharge rate from the site, and are currently in discussion with HCC to determine their response as statutory consultee on surface water drainage strategies.

We look forward to hearing your response on the above comments.

Yours sincerely,

For RSK LDE Limited

Mason Durant
Hydrologist



Appendix A: EA groundwater mapping

Appendix B: EA borehole records




APPENDIX A

EA groundwater mapping

Aerial survey data - groundwater flooding centred on: Crondall

Created on 30/11/2016_CH

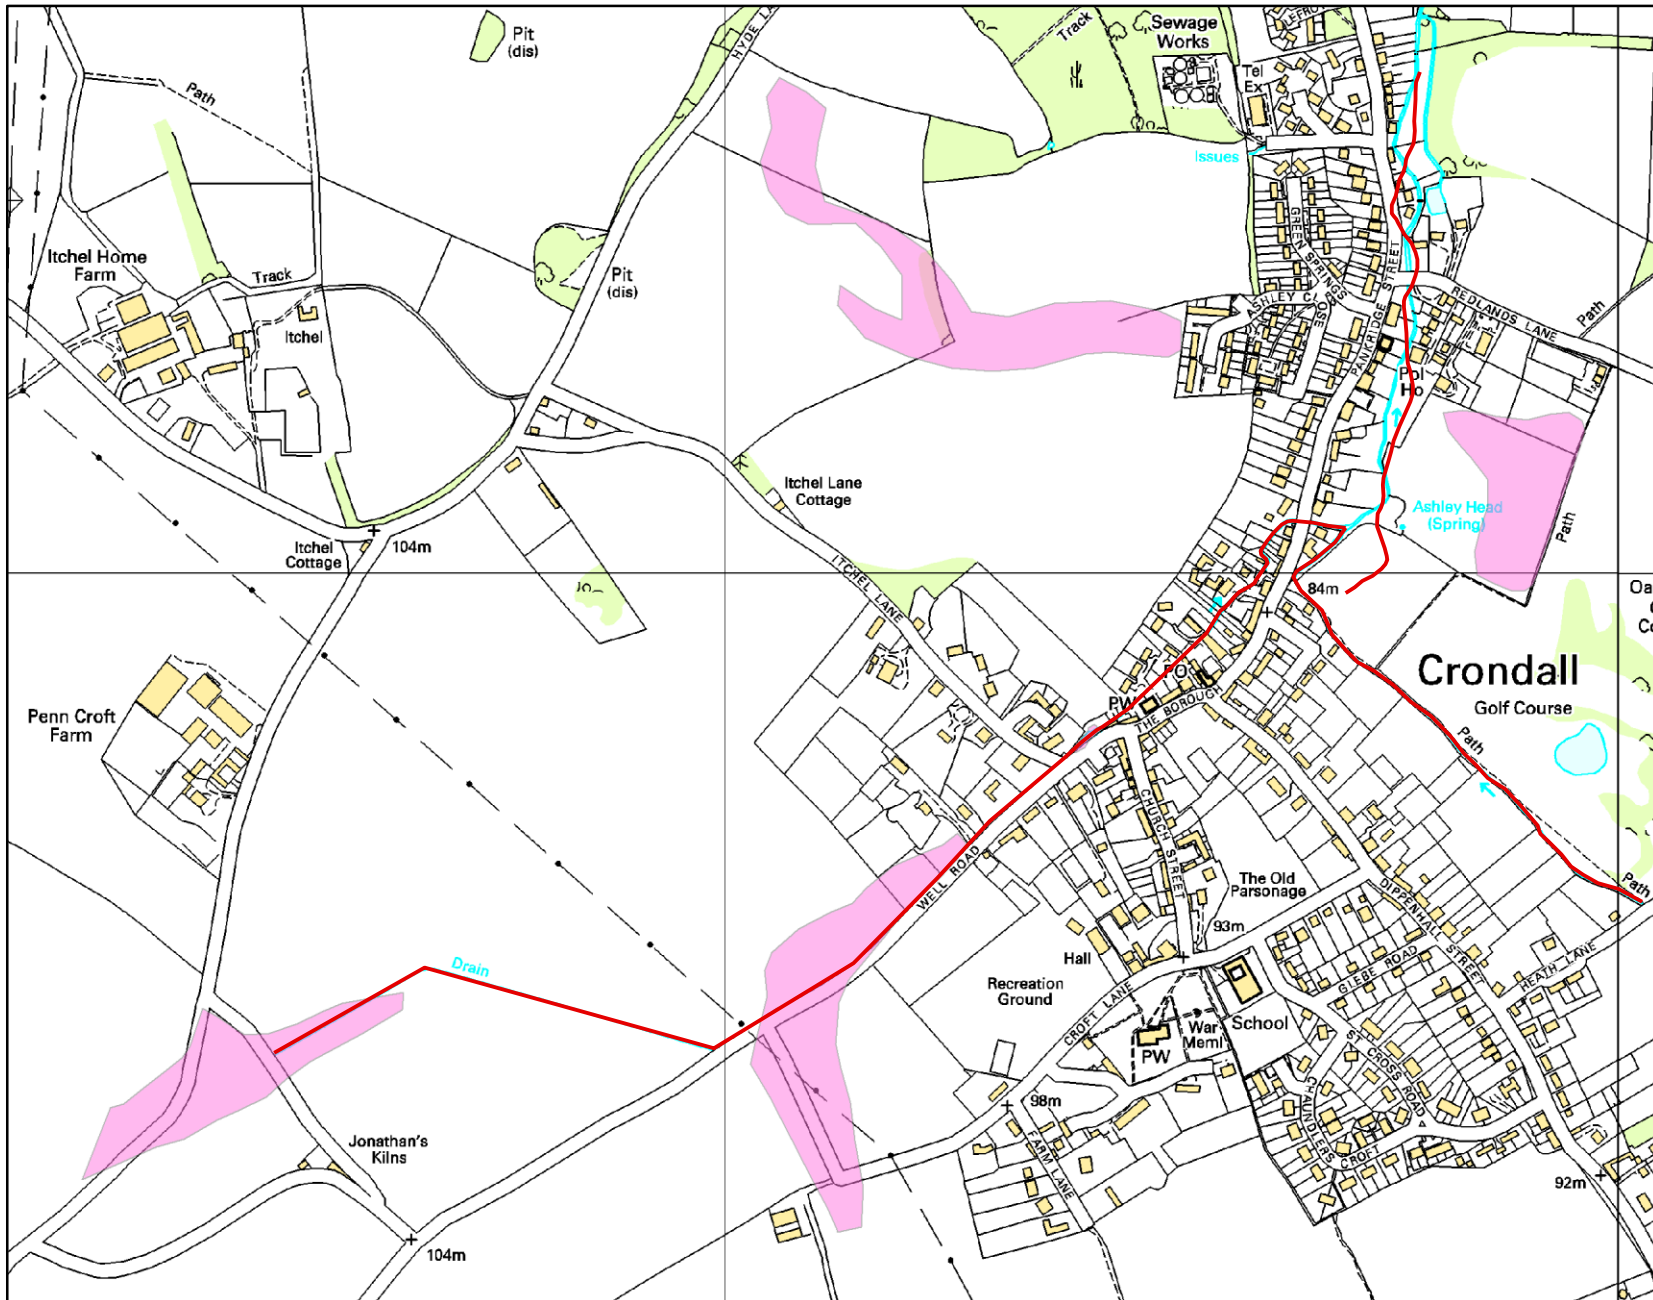



Kilometres



0 0.08 0.16

Legend

-  Main River
-  Crondall_2014

DRAFT ONLY



APPENDIX B

EA borehole records

Published by: Environment Agency
Source system: WISKI

Date created: 2016-12-01
Time created: 14:38:44
Machine ID: EAMERCTRXS23

ENVIRONMENT AGENCY DISCLAIMER:

The information provided is based on that currently available to the Agency. The Agency and its officers accept no liability whatsoever for any loss or damage arising from the interpretation or use of the information.

Flag definitions

Number	Name	Description
1	Good	Best data quality.
2	Suspect	Failed the latest quality control or there are strong grounds for suspecting the accuracy of the observation. This is better than missing.
3	Estimated	Estimated value (e.g. modelled value).
4	Unchecked	This value has not undergone sufficient quality control.
5	Missing	Gaps / missing data.
6	Complete	The source data set is complete (e.g. daily summary derived from all 96 values from a 15-min measured series).
7	Incomplete	The source data set is not complete, but enough data is provided to calculate the summary data.
8	Auto validated	The data has been subject to automatic validation routines.
9	Edited	The data value has been edited; this may be a manual or automatic process. This may be associated with a reason for edit and or comment.
10	Extrapolated	Flows are above or below the limit of a stage-discharge relationship and have been extrapolated. These flows will occur between Within Rating and Beyond Limit of Rating flags.
11	Within rating	The flows are within the upper and lower limits of the stage-discharge rating.
12	No rating	There is no rating present for this data.
13	Beyond upper limit	Beyond upper limit of rating when flows calculated using a stage-discharge equation.
14	Beyond lower limit	Beyond lower limit of rating when flows calculated using a stage-discharge equation.
15	Head only	Indicates the Upstream Head only has been used in the flow calculation.
16	Tail - modular	Indicates tail water level used in the flow calculation and the weir was found to be modular.
17	Tail - non-modular	Indicates tail water level used in the flow calculation. The weir was found to be non-modular so a reduction factor has been applied to the data.
18	Tail - extremely non-modular	Indicates tail water level used in the flow calculation. The weir was found to be extremely non-modular so a drowned flow reduction factor has been applied to the data.
19	Crest - modular	Indicates pressure-tapping level used in the flow calculation and the weir was found to be modular.
20	Crest - non-modular	Indicates pressure-tapping level used in the flow calculation. The weir was found to be non-modular so a reduction factor has been applied to the data.
21	Crest - extremely non-modular	Indicates pressure-tapping level used in the flow calculation. The weir was found to be extremely non-modular so a drowned flow reduction factor has been applied to the data.
22	Engineer on Site	Indicates an engineer is on site, some data values may be affected by their work.
23	Normal QC complete	The Quality Control procedures have been completed.
24	Test Calibration Data	The data has been generated during the process of testing and calibrating the sensor.
25	Item in Alarm	The item that is being recorded by the Telemetry system is in a state of alarm.
26	Off Scan/Disable	The telemetry outstation is set to Off Scan or has been disabled.
27	Out of Range	The data recorded is out of the minimum or maximum calibrated range of the measuring sensor.
28	Manually Entered Data	A user has manually updated the source system.
29	Master Station Override	The telemetry master station override is active. This may have affected the data.
30	Invalid State	This indicates the Digital Status is invalid from the source system.
31	Invalid Time	This indicates the time is invalid from the source system.
32	Trace	Some rain has fallen but it is too little to measure.
33	Accumulation (Start)	First value for an accumulated data block.
34	Accumulation	Rainfall that has accumulated over more than one day between readings for a storage type gauge. Note that there must be Start and End of accumulation flags.
35	Accumulation (End)	Last value for an accumulated data block.
36	Snow	Precipitation that has fallen as snow but has not been converted to rainfall equivalent.
37	Snow converted to rain	Precipitation that has fallen as snow that has been converted to rainfall equivalent.
38	Well Dry	Maximum depth of well reached (i.e. the bottom): there could be water at greater depth in the aquifer.
39	Automatic Estimate	Estimate/correction derived automatically from a program with no manual intervention.
40	Manual Estimate	Estimate/corrected value has been set manually (with or without assistance from a program).
41	Observer Estimate	Estimate/correction has been obtained retrospectively from the observer/station.
42	Derived Estimate	Precipitation estimate/correction has been derived from snow/rainfall equivalence, or trace estimate/correction has been set for consistency with present weather.
43	Units Correction	Correction has been obtained by changing units of measurement.
44	Systematic Correction	Correction has been obtained by applying a systematic adjustment.
45	Inaccessible	Measurement impossible, because of snow, etc.
46	Unavailable	An estimate where the original value is not available.
47	Unreliable Estimate	An unreliable estimate (used in radiation QC).
48	Correction	A correction (a reported value is assumed to be in error).
49	Reverted to Original	Value reverted to original.
50	Raw	Original value verified by observer.
51	Original	The data value is the original or raw value retrieved from an external source without any verification.
52	Completed	The original data value was missing and was replaced by a value that was derived by a model.
53	Failed SDB/MetDB	Failed Synoptic Database (SDB) or Met Office Database (MetDB) QC check.
54	Failed MIDAS	Failed MIDAS validation.
55	Position/Movement Failed	Failed climate QC marine position or movement check.
56	Range Failed	Failed climate QC range check.
57	Consistency Failed	Failed climate QC internal consistency check.
58	Sequence check Failed	Failed climate QC sequence check.
59	Areal check Failed	Failed climate QC areal check.
60	MO QC level 0	Initial climate QC program has not been run.
61	MO QC level 1	Initial climate QC program has been run.
62	MO QC level 2	Initial QC queries processed.
63	MO QC level 4	Further range or internal consistency or sequence checks job(s) run and queries processed.
64	MO QC level 6	Final (or only) areal or buddy job run and queries ceased.
65	MO QC level 8	Final (or only) monthly job(s) run and queries processed.
66	High Tide	Water level at High tide: note that this is usually a forecast.
67	Low Tide	Water level at Low tide: note that this is usually forecast.
68	Part Missing	Part of summary data is missing when values are infilled.
69	Infilled	Summary data infilled

Station ID SU74/11
 Name 6 COTTAGES_Clean
 NGR SU79474866
 Region EA South East
 No. Datasets 7
 Last Row 807

Parameter: Water Level Groundwater
 Data Type: Unspecified Instantaneous
 Units: mAOD
 Start: 02/02/1950 00:00:00
 End: 14/11/2008 12:31:00

Date/time	Value	Quality	Flag	Flag 1
02/02/1950 12:00:00	84.36	Good		1
01/03/1950 12:00:00	85.79	Good		1
04/04/1950 12:00:00	85.46	Good		1
02/05/1950 12:00:00	85.79	Good		1
13/06/1950 12:00:00	84.57	Good		1
11/07/1950 12:00:00	83.83	Good		1
04/08/1950 12:00:00	83.75	Good		1
20/09/1950 12:00:00	83.27	Good		1
17/10/1950 12:00:00	83.17	Good		1
12/02/1951 12:00:00	86.85	Good		1
06/03/1951 12:00:00	87.64	Good		1
04/04/1951 12:00:00	87.59	Good		1
04/05/1951 12:00:00	87.31	Good		1
06/06/1951 12:00:00	86.5	Good		1
20/07/1951 12:00:00	85.33	Good		1
01/08/1951 12:00:00	85.03	Good		1
05/09/1951 12:00:00	84.47	Good		1
05/10/1951 12:00:00	84.42	Good		1
02/11/1951 12:00:00	84.29	Good		1
04/12/1951 12:00:00	86.85	Good		1
04/02/1952 12:00:00	86.68	Good		1
06/03/1952 12:00:00	86.57	Good		1
07/04/1952 12:00:00	85.92	Good		1
06/05/1952 12:00:00	85.69	Good		1
10/06/1952 12:00:00	85.35	Good		1
09/07/1952 12:00:00	85.23	Good		1
01/08/1952 12:00:00	84.01	Good		1
09/09/1952 12:00:00	83.53	Good		1
10/10/1952 12:00:00	83.22	Good		1
10/11/1952 12:00:00	83.65	Good		1
12/12/1952 12:00:00	84.59	Good		1
06/01/1953 12:00:00	85.15	Good		1
17/02/1953 12:00:00	85.41	Good		1
17/03/1953 12:00:00	85.18	Good		1
14/04/1953 12:00:00	84.72	Good		1

20/05/1953 12:00:00	84.19 Good	1
18/06/1953 12:00:00	83.83 Good	1
10/07/1953 12:00:00	83.5 Good	1
18/08/1953 12:00:00	82.79 Good	1
03/09/1953 12:00:00	82.46 Good	1
20/10/1953 12:00:00	81.24 Good	1
20/11/1953 12:00:00	82.21 Good	1
07/01/1954 12:00:00	83.3 Good	1
18/02/1954 12:00:00	83.58 Good	1
11/03/1954 12:00:00	84.49 Good	1
11/05/1954 12:00:00	84.52 Good	1
07/07/1954 12:00:00	85.28 Good	1
03/09/1954 12:00:00	82.89 Good	1
05/10/1954 12:00:00	82.18 Good	1
17/11/1954 12:00:00	82.43 Good	1
09/12/1954 12:00:00	85.41 Good	1
11/01/1955 12:00:00	86.37 Good	1
09/03/1955 12:00:00	86.3 Good	1
19/04/1955 12:00:00	85.48 Good	1
18/05/1955 12:00:00	84.87 Good	1
13/07/1955 12:00:00	85.23 Good	1
29/08/1955 12:00:00	80.3 Good	1
13/12/1955 12:00:00	84.49 Good	1
30/01/1956 12:00:00	85.48 Good	1
28/02/1956 12:00:00	86.19 Good	1
06/04/1956 12:00:00	85.28 Good	1
07/05/1956 12:00:00	84.52 Good	1
02/07/1956 12:00:00	84.21 Good	1
10/09/1956 12:00:00	83.6 Good	1
13/11/1956 12:00:00	84.11 Good	1
14/01/1957 12:00:00	84.97 Good	1
19/02/1957 12:00:00	86.32 Good	1
09/04/1957 12:00:00	86.17 Good	1
28/05/1957 12:00:00	84.95 Good	1
10/07/1957 12:00:00	83.88 Good	1
19/09/1957 12:00:00	83.25 Good	1
11/11/1957 12:00:00	83.5 Good	1
30/12/1957 12:00:00	84.24 Good	1
03/03/1958 12:00:00	85.63 Good	1
28/04/1958 12:00:00	85.51 Good	1
04/06/1958 12:00:00	84.87 Good	1
01/07/1958 12:00:00	84.52 Good	1
07/08/1958 12:00:00	83.96 Good	1
04/09/1958 12:00:00	84.03 Good	1
01/10/1958 12:00:00	84.34 Good	1
06/11/1958 12:00:00	85.61 Good	1
16/12/1958 12:00:00	85.69 Good	1
09/02/1959 12:00:00	86.47 Good	1
17/03/1959 12:00:00	86.19 Good	1

20/04/1959 12:00:00	85.79 Good	1
19/05/1959 12:00:00	85.43 Good	1
21/07/1959 12:00:00	84.03 Good	1
25/08/1959 12:00:00	83.53 Good	1
22/09/1959 12:00:00	82.99 Good	1
26/10/1959 12:00:00	82.13 Good	1
24/11/1959 12:00:00	81.82 Good	1
21/12/1959 12:00:00	83.22 Good	1
20/01/1960 12:00:00	85.18 Good	1
11/02/1960 12:00:00	86.4 Good	1
24/03/1960 12:00:00	86.45 Good	1
13/04/1960 12:00:00	86.19 Good	1
17/05/1960 12:00:00	85.48 Good	1
15/06/1960 12:00:00	84.74 Good	1
20/07/1960 12:00:00	83.91 Good	1
29/08/1960 12:00:00	83.63 Good	1
21/09/1960 12:00:00	83.63 Good	1
18/10/1960 12:00:00	85.46 Good	1
08/11/1960 12:00:00	86.93 Good	1
07/12/1960 12:00:00	87.59 Good	1
05/01/1961 12:00:00	87.54 Good	1
08/02/1961 12:00:00	87.56 Good	1
03/03/1961 12:00:00	87.34 Good	1
11/04/1961 12:00:00	86.57 Good	1
09/05/1961 12:00:00	86.09 Good	1
12/06/1961 12:00:00	85.38 Good	1
17/07/1961 12:00:00	84.49 Good	1
22/08/1961 12:00:00	83.71 Good	1
18/09/1961 12:00:00	83.32 Good	1
18/10/1961 12:00:00	83.2 Good	1
15/11/1961 12:00:00	83.25 Good	1
06/02/1962 12:00:00	86.22 Good	1
01/03/1962 12:00:00	86.09 Good	1
02/04/1962 12:00:00	85.35 Good	1
01/05/1962 12:00:00	84.92 Good	1
01/06/1962 12:00:00	84.44 Good	1
03/07/1962 12:00:00	83.81 Good	1
01/08/1962 12:00:00	83.27 Good	1
03/09/1962 12:00:00	82.82 Good	1
02/10/1962 12:00:00	82.31 Good	1
02/11/1962 12:00:00	82.13 Good	1
03/12/1962 12:00:00	82.84 Good	1
01/02/1963 12:00:00	83.02 Good	1
01/03/1963 12:00:00	83.81 Good	1
01/04/1963 12:00:00	85.13 Good	1
01/05/1963 12:00:00	85.63 Good	1
01/06/1963 12:00:00	85.48 Good	1
01/07/1963 12:00:00	84.21 Good	1
27/08/1963 12:00:00	83.78 Good	1

25/09/1963 12:00:00	83.68 Good	1
24/10/1963 12:00:00	83.45 Good	1
29/11/1963 12:00:00	84.44 Good	1
20/02/1964 12:00:00	84.74 Good	1
17/03/1964 12:00:00	84.8 Good	1
15/04/1964 12:00:00	85.63 Good	1
01/05/1964 12:00:00	85.69 Good	1
01/06/1964 12:00:00	85.33 Good	1
01/07/1964 12:00:00	85.15 Good	1
14/08/1964 12:00:00	84.24 Good	1
15/09/1964 12:00:00	83.63 Good	1
16/10/1964 12:00:00	83.27 Good	1
16/11/1964 12:00:00	82.92 Good	1
16/12/1964 12:00:00	82.76 Good	1
13/01/1965 12:00:00	83.37 Good	1
16/02/1965 12:00:00	84.19 Good	1
16/03/1965 12:00:00	84.06 Good	1
15/04/1965 12:00:00	84.32 Good	1
19/05/1965 12:00:00	83.93 Good	1
15/06/1965 12:00:00	83.58 Good	1
16/07/1965 12:00:00	83.22 Good	1
12/08/1965 12:00:00	82.97 Good	1
15/09/1965 12:00:00	82.46 Good	1
15/10/1965 12:00:00	82.89 Good	1
15/11/1965 12:00:00	82.89 Good	1
16/12/1965 12:00:00	84.16 Good	1
17/01/1966 12:00:00	85.76 Good	1
15/02/1966 12:00:00	86.14 Good	1
15/03/1966 12:00:00	86.93 Good	1
15/04/1966 12:00:00	86.35 Good	1
16/05/1966 12:00:00	86.3 Good	1
15/06/1966 12:00:00	85.89 Good	1
15/07/1966 12:00:00	85.18 Good	1
16/08/1966 12:00:00	84.62 Good	1
15/09/1966 12:00:00	84.16 Good	1
14/10/1966 12:00:00	83.81 Good	1
15/11/1966 12:00:00	84.8 Good	1
16/12/1966 12:00:00	84.95 Good	1
17/01/1967 12:00:00	85.23 Good	1
20/02/1967 12:00:00	86.07 Good	1
14/03/1967 12:00:00	86.68 Good	1
14/04/1967 12:00:00	86.57 Good	1
25/05/1967 12:00:00	86.24 Good	1
15/06/1967 12:00:00	85.99 Good	1
15/07/1967 12:00:00	85.31 Good	1
15/08/1967 12:00:00	84.44 Good	1
15/09/1967 12:00:00	83.91 Good	1
14/10/1967 12:00:00	83.75 Good	1
15/11/1967 12:00:00	85.81 Good	1

13/12/1967 12:00:00	85.81 Good	1
15/01/1968 12:00:00	86.07 Good	1
15/02/1968 12:00:00	86.24 Good	1
15/03/1968 12:00:00	86.02 Good	1
16/04/1968 12:00:00	85.35 Good	1
14/05/1968 12:00:00	85.1 Good	1
15/06/1968 12:00:00	84.77 Good	1
15/07/1968 12:00:00	84.54 Good	1
15/08/1968 12:00:00	84.34 Good	1
16/09/1968 12:00:00	85.48 Good	1
15/10/1968 12:00:00	86.68 Good	1
15/11/1968 12:00:00	86.68 Good	1
16/12/1968 12:00:00	86.22 Good	1
15/01/1969 12:00:00	87.01 Good	1
20/02/1969 12:00:00	87.24 Good	1
15/03/1969 12:00:00	87.03 Good	1
16/04/1969 12:00:00	86.73 Good	1
14/05/1969 12:00:00	86.19 Good	1
16/06/1969 12:00:00	85.28 Good	1
16/07/1969 12:00:00	84.52 Good	1
18/08/1969 12:00:00	84.11 Good	1
15/09/1969 12:00:00	83.86 Good	1
15/10/1969 12:00:00	83.48 Good	1
15/11/1969 12:00:00	83.32 Good	1
15/12/1969 12:00:00	83.93 Good	1
14/01/1970 12:00:00	84.52 Good	1
16/02/1970 12:00:00	85.63 Good	1
10/03/1970 12:00:00	86.04 Good	1
15/04/1970 12:00:00	85.69 Good	1
16/05/1970 12:00:00	85.2 Good	1
17/06/1970 12:00:00	84.54 Good	1
15/07/1970 12:00:00	83.91 Good	1
13/08/1970 12:00:00	83.45 Good	1
16/09/1970 12:00:00	83.04 Good	1
14/10/1970 12:00:00	82.59 Good	1
16/11/1970 12:00:00	81.22 Good	1
15/12/1970 12:00:00	84.34 Good	1
20/01/1971 12:00:00	84.72 Good	1
11/02/1971 12:00:00	86.24 Good	1
16/03/1971 12:00:00	85.99 Good	1
19/04/1971 12:00:00	85.81 Good	1
17/05/1971 12:00:00	85.66 Good	1
15/06/1971 12:00:00	85.53 Good	1
17/07/1971 12:00:00	85.63 Good	1
18/08/1971 12:00:00	84.87 Good	1
15/09/1971 12:00:00	84.24 Good	1
16/10/1971 12:00:00	83.73 Good	1
15/11/1971 12:00:00	83.53 Good	1
16/12/1971 12:00:00	83.78 Good	1

15/01/1972 12:00:00	83.73 Good	1
22/02/1972 12:00:00	85.1 Good	1
16/03/1972 12:00:00	86.09 Good	1
17/04/1972 12:00:00	85.94 Good	1
15/05/1972 12:00:00	85.41 Good	1
15/06/1972 12:00:00	84.9 Good	1
14/07/1972 12:00:00	84.21 Good	1
18/08/1972 12:00:00	83.45 Good	1
19/09/1972 12:00:00	83.3 Good	1
17/10/1972 12:00:00	82.89 Good	1
18/11/1972 12:00:00	82.38 Good	1
16/01/1973 12:00:00	84.72 Good	1
17/02/1973 12:00:00	84.42 Good	1
14/03/1973 12:00:00	84.11 Good	1
17/04/1973 12:00:00	83.86 Good	1
15/05/1973 12:00:00	83.71 Good	1
20/06/1973 12:00:00	83.45 Good	1
18/07/1973 12:00:00	83.17 Good	1
15/08/1973 12:00:00	82.89 Good	1
18/09/1973 12:00:00	82.08 Good	1
16/10/1973 12:00:00	81.88 Good	1
13/11/1973 12:00:00	81.52 Good	1
17/12/1973 12:00:00	81.29 Good	1
15/01/1974 12:00:00	83.27 Good	1
13/02/1974 12:00:00	85.2 Good	1
13/03/1974 12:00:00	86.17 Good	1
17/04/1974 12:00:00	85.58 Good	1
15/05/1974 12:00:00	84.97 Good	1
18/06/1974 12:00:00	85.48 Good	1
23/07/1974 12:00:00	84.42 Good	1
23/08/1974 12:00:00	83.32 Good	1
17/09/1974 12:00:00	82.84 Good	1
15/10/1974 12:00:00	84.26 Good	1
19/11/1974 12:00:00	85.76 Good	1
28/12/1974 12:00:00	86.85 Good	1
14/01/1975 12:00:00	86.55 Good	1
18/02/1975 12:00:00	87.31 Good	1
23/03/1975 12:00:00	86.88 Good	1
23/04/1975 12:00:00	86.8 Good	1
21/05/1975 12:00:00	86.37 Good	1
18/06/1975 12:00:00	85.81 Good	1
15/07/1975 12:00:00	84.95 Good	1
06/08/1975 12:00:00	84.38 Good	1
16/09/1975 12:00:00	83.68 Good	1
14/10/1975 12:00:00	83.55 Good	1
19/11/1975 12:00:00	83.58 Good	1
17/12/1975 12:00:00	84.06 Good	1
17/01/1976 12:00:00	83.88 Good	1
14/02/1976 12:00:00	83.58 Good	1

15/03/1976 12:00:00	83.38 Good	1
14/04/1976 12:00:00	83.04 Good	1
17/05/1976 12:00:00	82.49 Good	1
15/06/1976 12:00:00	81.09 Good	1
13/07/1976 12:00:00	80.96 Good	1
15/08/1976 12:00:00	80.64 Suspect	2
16/11/1976 12:00:00	83.58 Good	1
14/12/1976 12:00:00	85.23 Good	1
18/01/1977 12:00:00	86.34 Good	1
15/02/1977 12:00:00	86.85 Good	1
15/03/1977 12:00:00	87.03 Good	1
16/05/1977 12:00:00	86.34 Good	1
14/06/1977 12:00:00	85.71 Good	1
25/07/1977 12:00:00	84.7 Good	1
13/09/1977 12:00:00	83.81 Good	1
17/10/1977 12:00:00	83.43 Good	1
15/11/1977 12:00:00	82.59 Good	1
19/12/1977 12:00:00	84.29 Good	1
16/01/1978 12:00:00	84.85 Good	1
13/02/1978 12:00:00	86.19 Good	1
14/03/1978 12:00:00	86.37 Good	1
17/04/1978 12:00:00	86.3 Good	1
16/05/1978 12:00:00	86.34 Good	1
13/06/1978 12:00:00	86.04 Good	1
17/07/1978 12:00:00	85.09 Good	1
15/08/1978 12:00:00	84.54 Good	1
18/09/1978 12:00:00	83.88 Good	1
17/10/1978 12:00:00	83.48 Good	1
14/11/1978 12:00:00	83.2 Good	1
18/12/1978 12:00:00	83.42 Good	1
16/01/1979 12:00:00	84.72 Good	1
27/02/1979 12:00:00	85.2 Good	1
15/03/1979 12:00:00	84.24 Good	1
17/04/1979 12:00:00	86.85 Good	1
15/05/1979 12:00:00	86.55 Good	1
16/06/1979 12:00:00	86.12 Good	1
16/07/1979 12:00:00	85.38 Good	1
13/08/1979 12:00:00	84.64 Good	1
17/09/1979 12:00:00	83.92 Good	1
16/10/1979 12:00:00	83.61 Good	1
13/11/1979 12:00:00	83.5 Good	1
18/12/1979 12:00:00	83.86 Good	1
15/01/1980 12:00:00	84.82 Good	1
18/02/1980 12:00:00	85.23 Good	1
17/03/1980 12:00:00	85.38 Good	1
15/04/1980 12:00:00	85.53 Good	1
13/05/1980 12:00:00	85.2 Good	1
16/06/1980 12:00:00	84.42 Good	1
24/07/1980 12:00:00	83.75 Good	1

13/08/1980 12:00:00	83.55 Good	1
16/09/1980 12:00:00	83.2 Good	1
15/10/1980 12:00:00	83.49 Good	1
17/11/1980 12:00:00	85.12 Good	1
14/12/1980 12:00:00	84.35 Good	1
20/01/1981 12:00:00	84.52 Good	1
16/02/1981 12:00:00	84.55 Good	1
19/03/1981 12:00:00	84.82 Good	1
16/04/1981 12:00:00	86.56 Good	1
15/05/1981 12:00:00	85.37 Good	1
15/06/1981 12:00:00	85.31 Good	1
15/07/1981 12:00:00	84.69 Good	1
18/08/1981 12:00:00	84.31 Good	1
16/09/1981 12:00:00	83.87 Good	1
19/10/1981 12:00:00	84.33 Good	1
16/11/1981 12:00:00	84.76 Good	1
21/01/1982 12:00:00	86.11 Good	1
15/02/1982 12:00:00	86.23 Good	1
17/03/1982 12:00:00	88.13 Good	1
15/04/1982 12:00:00	86.11 Good	1
18/05/1982 12:00:00	85.98 Good	1
16/06/1982 12:00:00	84.74 Good	1
14/07/1982 12:00:00	84.14 Good	1
14/08/1982 12:00:00	84.64 Good	1
17/09/1982 12:00:00	83.18 Good	1
19/10/1982 12:00:00	83.27 Good	1
18/11/1982 12:00:00	84.34 Good	1
15/12/1982 12:00:00	86.77 Good	1
17/01/1983 12:00:00	86.86 Good	1
17/03/1983 12:00:00	86.01 Good	1
15/05/1983 12:00:00	85.74 Good	1
14/06/1983 12:00:00	85.43 Good	1
15/07/1983 12:00:00	85.14 Good	1
18/08/1983 12:00:00	84.34 Good	1
16/09/1983 12:00:00	83.86 Good	1
14/10/1983 12:00:00	83.59 Good	1
16/11/1983 12:00:00	83.46 Good	1
16/12/1983 12:00:00	83.69 Good	1
12/01/1984 12:00:00	84.46 Good	1
16/02/1984 12:00:00	85.92 Good	1
15/03/1984 12:00:00	85.99 Good	1
14/04/1984 12:00:00	86.03 Good	1
15/05/1984 12:00:00	85.69 Good	1
14/06/1984 12:00:00	84.66 Good	1
14/07/1984 12:00:00	84.42 Good	1
15/08/1984 12:00:00	83.74 Good	1
13/09/1984 12:00:00	84.04 Good	1
13/10/1984 12:00:00	83.5 Good	1
14/11/1984 12:00:00	84 Good	1

14/12/1984 12:00:00	85.34 Good	1
14/01/1985 12:00:00	86.16 Good	1
21/02/1985 12:00:00	86.4 Good	1
15/03/1985 12:00:00	86.29 Good	1
16/04/1985 12:00:00	85.94 Good	1
15/05/1985 12:00:00	85.56 Good	1
14/06/1985 12:00:00	84.98 Good	1
12/07/1985 12:00:00	84.48 Good	1
13/08/1985 12:00:00	84.01 Good	1
17/09/1985 12:00:00	83.74 Good	1
15/10/1985 12:00:00	83.64 Good	1
13/11/1985 12:00:00	83.34 Good	1
14/12/1985 12:00:00	83.6 Good	1
15/01/1986 12:00:00	85.74 Good	1
14/02/1986 12:00:00	86.64 Good	1
14/03/1986 12:00:00	86.24 Good	1
16/04/1986 12:00:00	85.71 Good	1
15/05/1986 12:00:00	85.57 Good	1
13/06/1986 12:00:00	85.1 Good	1
15/07/1986 12:00:00	84.36 Good	1
14/08/1986 12:00:00	83.84 Good	1
16/09/1986 12:00:00	83.52 Good	1
17/10/1986 12:00:00	83.23 Good	1
13/11/1986 12:00:00	83.45 Good	1
13/12/1986 12:00:00	84.99 Good	1
29/01/1987 12:00:00	85.7 Good	1
23/02/1987 12:00:00	85.51 Good	1
13/03/1987 12:00:00	85.35 Good	1
15/04/1987 12:00:00	85.64 Good	1
15/05/1987 12:00:00	84.99 Good	1
18/06/1987 12:00:00	85.06 Good	1
15/07/1987 12:00:00	84.4 Good	1
15/08/1987 12:00:00	83.78 Good	1
15/09/1987 12:00:00	83.56 Good	1
24/10/1987 12:00:00	82.82 Good	1
15/11/1987 12:00:00	86.12 Good	1
15/12/1987 12:00:00	86.23 Good	1
13/01/1988 12:00:00	86.9 Good	1
13/02/1988 12:00:00	87.16 Good	1
15/03/1988 12:00:00	86.88 Good	1
15/04/1988 12:00:00	86.34 Good	1
16/05/1988 12:00:00	85.71 Good	1
11/06/1988 12:00:00	85.04 Good	1
15/07/1988 12:00:00	84.37 Good	1
15/08/1988 12:00:00	83.86 Good	1
14/09/1988 12:00:00	83.65 Good	1
15/10/1988 12:00:00	83.68 Good	1
15/11/1988 12:00:00	83.85 Good	1
16/12/1988 12:00:00	83.59 Good	1

13/01/1989 12:00:00	83.49 Good	1
17/02/1989 12:00:00	83.43 Good	1
17/03/1989 12:00:00	84.11 Good	1
14/04/1989 12:00:00	85.13 Good	1
19/05/1989 12:00:00	84.91 Good	1
16/06/1989 12:00:00	84.31 Good	1
15/07/1989 12:00:00	83.33 Good	1
15/08/1989 12:00:00	81.26 Good	1
16/09/1989 12:00:00	82.54 Good	1
15/10/1989 12:00:00	82.11 Good	1
17/11/1989 12:00:00	82.3 Good	1
19/12/1989 12:00:00	83.09 Good	1
15/01/1990 12:00:00	82.38 Good	1
15/02/1990 12:00:00	87.82 Good	1
15/03/1990 12:00:00	87.41 Good	1
18/04/1990 12:00:00	86.46 Good	1
15/05/1990 12:00:00	85.58 Good	1
26/06/1990 12:00:00	84.11 Good	1
20/07/1990 12:00:00	83.45 Good	1
16/08/1990 12:00:00	83.12 Good	1
26/09/1990 12:00:00	82.2 Good	1
16/10/1990 12:00:00	81.93 Good	1
16/11/1990 12:00:00	81.74 Good	1
11/12/1990 12:00:00	81.72 Good	1
10/01/1991 12:00:00	83.09 Good	1
13/02/1991 12:00:00	84.54 Good	1
20/03/1991 12:00:00	84.74 Good	1
15/04/1991 12:00:00	84.77 Good	1
20/05/1991 12:00:00	84.36 Good	1
12/06/1991 12:00:00	83.96 Good	1
17/07/1991 12:00:00	83.43 Good	1
09/08/1991 12:00:00	82.99 Good	1
12/09/1991 12:00:00	82.07 Good	1
17/10/1991 12:00:00	81.42 Good	1
22/11/1991 12:00:00	81.54 Good	1
17/12/1991 12:00:00	81.94 Good	1
17/01/1992 12:00:00	82.14 Good	1
19/02/1992 12:00:00	82.24 Good	1
13/03/1992 12:00:00	82.59 Good	1
14/04/1992 12:00:00	82.4 Good	1
18/05/1992 12:00:00	83.03 Good	1
17/06/1992 12:00:00	82.6 Good	1
13/07/1992 12:00:00	81.96 Good	1
19/08/1992 12:00:00	81.75 Good	1
16/09/1992 12:00:00	81.49 Good	1
20/10/1992 12:00:00	82.89 Good	1
17/11/1992 12:00:00	84.04 Good	1
15/12/1992 12:00:00	85.89 Good	1
14/01/1993 12:00:00	86.09 Good	1

26/02/1993 12:00:00	86.49 Good	1
16/03/1993 12:00:00	86.03 Good	1
16/04/1993 12:00:00	85.56 Good	1
17/05/1993 12:00:00	85.23 Good	1
16/06/1993 12:00:00	84.63 Good	1
19/07/1993 12:00:00	84.01 Good	1
16/08/1993 12:00:00	84.44 Good	1
09/09/1993 12:00:00	83.24 Good	1
12/10/1993 12:00:00	84.15 Good	1
11/11/1993 12:00:00	84.96 Good	1
14/12/1993 12:00:00	84.52 Good	1
14/01/1994 12:00:00	86.89 Good	1
15/02/1994 12:00:00	87.12 Good	1
15/03/1994 12:00:00	86.84 Good	1
19/04/1994 12:00:00	86.34 Good	1
01/07/1994 12:00:00	85.94 Good	1
26/08/1994 12:00:00	84.69 Good	1
09/09/1994 12:00:00	83.74 Good	1
12/10/1994 12:00:00	83.26 Good	1
15/11/1994 12:00:00	85.04 Good	1
23/12/1994 12:00:00	85.22 Good	1
16/01/1995 12:00:00	85.66 Good	1
22/02/1995 12:00:00	87.44 Good	1
02/04/1995 12:00:00	87.25 Good	1
19/05/1995 12:00:00	85.84 Good	1
13/07/1995 12:00:00	84.06 Good	1
22/08/1995 12:00:00	82.44 Good	1
22/09/1995 12:00:00	82.19 Good	1
30/10/1995 12:00:00	82.99 Good	1
11/01/1996 12:00:00	84.09 Good	1
15/03/1996 12:00:00	85.35 Good	1
15/05/1996 12:00:00	84.74 Good	1
18/06/1996 12:00:00	83.99 Good	1
22/07/1996 12:00:00	83.44 Good	1
19/08/1996 12:00:00	82.84 Good	1
15/10/1996 12:00:00	81.89 Good	1
21/11/1996 12:00:00	82.74 Good	1
20/12/1996 12:00:00	83.42 Good	1
13/01/1997 12:00:00	84.17 Good	1
20/02/1997 12:00:00	84.24 Good	1
09/12/1997 12:00:00	83.54 Good	1
27/01/1998 12:00:00	85.85 Good	1
24/02/1998 12:00:00	85.5 Good	1
31/03/1998 12:00:00	85.05 Good	1
21/04/1998 12:00:00	86.16 Good	1
15/05/1998 12:00:00	85.29 Good	1
11/06/1998 12:00:00	84.74 Good	1
13/08/1998 12:00:00	85.63 Good	1
01/02/1999 10:09:00	87.28 Good	1

26/02/1999 09:21:00	86.91 Good	1
30/03/1999 09:30:00	86.34 Good	1
29/04/1999 09:45:00	85.69 Good	1
28/05/1999 09:14:00	84.98 Good	1
30/06/1999 10:04:00	84.19 Good	1
30/07/1999 12:45:00	83.6 Good	1
31/08/1999 10:00:00	83.41 Good	1
27/09/1999 08:50:00	83.54 Good	1
29/10/1999 09:05:00	84.18 Good	1
30/11/1999 09:36:00	84.36 Good	1
30/12/1999 10:15:00	85.09 Good	1
31/01/2000 12:00:00	85.84 Good	1
28/02/2000 12:00:00	85.71 Good	1
31/03/2000 13:47:00	85.79 Good	1
28/04/2000 08:23:00	86.69 Good	1
30/05/2000 08:15:00	86.5 Good	1
05/06/2000 14:00:00	86.07 Good	1
12/07/2000 12:40:00	85.34 Good	1
09/08/2000 12:40:00	84.59 Good	1
11/09/2000 11:45:00	84 Good	1
10/10/2000 12:20:00	83.98 Good	1
16/11/2000 13:20:00	87.36 Good	1
22/12/2000 09:30:00	88.02 Good	1
23/01/2001 13:38:00	87.56 Good	1
23/02/2001 10:45:00	87.92 Good	1
02/05/2001 12:40:00	87.47 Good	1
19/06/2001 09:50:00	86.17 Good	1
12/07/2001 12:45:00	85.39 Good	1
15/08/2001 12:30:00	84.48 Good	1
07/09/2001 12:16:00	84.24 Good	1
09/10/2001 12:15:00	84.45 Good	1
15/11/2001 14:00:00	85.37 Good	1
10/12/2001 13:30:00	85.31 Good	1
16/01/2002 13:39:00	84.88 Good	1
13/02/2002 14:09:00	86.23 Good	1
08/03/2002 13:00:00	86.55 Good	1
11/04/2002 12:20:00	86.39 Good	1
03/05/2002 12:40:00	85.94 Good	1
14/06/2002 13:35:00	85.3 Good	1
08/07/2002 13:03:00	84.92 Good	1
09/08/2002 09:35:00	84.32 Good	1
12/09/2002 12:23:00	83.87 Good	1
18/10/2002 14:11:00	83.59 Good	1
18/11/2002 14:30:00	84.79 Good	1
16/12/2002 13:00:00	86.58 Good	1
24/01/2003 14:30:00	87.59 Good	1
20/02/2003 14:15:00	87.26 Good	1
31/03/2003 12:15:00	86.48 Good	1
17/04/2003 09:15:00	86.08 Good	1

15/05/2003 12:00:00	84.25 Good	1
19/06/2003 09:30:00	84.42 Good	1
18/07/2003 09:50:00	83.81 Good	1
20/08/2003 12:00:00	82.21 Good	1
24/09/2003 12:00:00	81.54 Good	1
29/10/2003 12:00:00	80.75 Good	1
29/11/2003 12:00:00	82.71 Good	1
19/12/2003 12:00:00	84.43 Good	1
27/01/2004 08:35:00	85.88 Good	1
23/02/2004 09:45:00	86.28 Good	1
26/03/2004 10:20:00	85.84 Good	1
30/04/2004 12:00:00	85.37 Good	1
25/05/2004 12:00:00	85.2 Good	1
21/06/2004 12:00:00	84.56 Good	1
23/07/2004 08:10:00	83.94 Good	1
24/08/2004 09:15:00	83.62 Good	1
30/09/2004 13:35:00	83.25 Good	1
27/10/2004 12:05:00	83.54 Good	1
12/11/2004 11:30:00	83.94 Good	1
15/12/2004 14:44:00	85.14 Good	1
06/01/2005 14:17:00	84.44 Good	1
10/02/2005 13:19:00	84.62 Good	1
01/03/2005 13:43:00	84.48 Good	1
10/04/2005 11:50:00	84.11 Good	1
04/05/2005 11:24:00	83.87 Good	1
08/06/2005 12:00:00	83.19 Good	1
08/07/2005 08:15:00	82.88 Good	1
05/08/2005 12:15:00	82.02 Good	1
07/09/2005 10:24:00	81.29 Good	1
06/10/2005 11:11:00	81.04 Good	1
02/11/2005 11:58:00	81.04 Good	1
02/12/2005 11:51:00	82.31 Good	1
13/01/2006 12:32:00	83.93 Good	1
03/02/2006 11:20:00	84.03 Good	1
03/03/2006 12:05:00	84.22 Good	1
20/04/2006 10:50:00	84.42 Good	1
26/05/2006 10:49:00	84.22 Good	1
29/06/2006 13:35:00	83.89 Good	1
20/07/2006 14:18:00	83.48 Good	1
10/08/2006 09:15:00	83.11 Good	1
19/09/2006 13:05:00	82.38 Good	1
10/10/2006 09:00:00	82.13 Good	1
08/11/2006 14:28:00	83.26 Good	1
13/12/2006 14:28:00	85.54 Good	1
09/01/2007 12:54:00	86.26 Good	1
14/02/2007 12:38:00	86.8 Good	1
13/03/2007 13:32:00	87.3 Good	1
27/04/2007 11:15:00	86.31 Good	1
31/05/2007 12:47:00	85.25 Good	1

18/06/2007 09:56:00	84.76	Good	1
11/07/2007 14:36:00	84.65	Good	1
23/08/2007 11:52:00	85.12	Good	1
20/09/2007 10:01:00	84.66	Good	1
25/10/2007 09:54:00	84.44	Good	1
28/11/2007 15:11:00	84.66	Good	1
28/12/2007 10:06:00	85.42	Good	1
21/01/2008 10:18:00	86.25	Good	1
28/02/2008 12:20:00	86.16	Good	1
27/03/2008 11:03:00	86	Good	1
18/04/2008 08:24:00	85.82	Good	1
20/05/2008 10:27:00	85.68	Good	1
20/06/2008 10:26:00	85.34	Good	1
22/07/2008 11:02:00	84.56	Good	1
27/08/2008 11:50:00	83.93	Good	1
18/09/2008 12:25:00	83.81	Good	1
16/10/2008 12:49:00	83.75	Good	1
14/11/2008 12:31:00	84	Good	1

From	To	Comment
02/02/1950 00:00:00	02/02/1950 11:59:00	There are no values in the time ra
15/08/1976 12:00:00	15/08/1976 12:00:00	DRY WELL - Value inserted for w
29/11/2003 12:00:00	29/11/2003 12:00:00	Datum is 92.34
06/10/2005 11:11:00	06/10/2005 11:11:00	Well dry. Well Depth entered as v
02/11/2005 11:58:00	02/11/2005 11:58:00	Well dry. Well depth entered as le

Parameter: Water Level Groundwater
 Data Type: Unspecified Instantaneous
 Units: mAOD
 Start: 14/11/2008 12:31:01
 End: 16/12/2008 11:33:59

Date/time Value Quality Flag Flag 1

Parameter: Water Level Groundwater
 Data Type: Unspecified Instantaneous
 Units: mAOD
 Start: 16/12/2008 11:34:00
 End: 15/12/2009 10:19:00

Date/time Value Quality Flag Flag 1

16/12/2008 11:34:00	84.52	Good	1
07/01/2009 13:09:00	84.76	Good	1
12/02/2009 11:11:00	86.34	Good	1
12/03/2009 10:56:00	86.59	Good	1
28/04/2009 10:53:00	85.5	Good	1
28/05/2009 15:45:00	84.56	Good	1

26/06/2009 10:30:00	84	Good	1
22/07/2009 14:14:00	83.46	Good	1
20/08/2009 12:50:00	83.17	Good	1
22/09/2009 14:32:00	82.83	Good	1
15/10/2009 14:22:00	82.75	Good	1
01/12/2009 11:19:00	84.61	Good	1
15/12/2009 10:19:00	86	Good	1

Parameter: Water Level Groundwater
 Data Type: Unspecified Instantaneous
 Units: mAOD
 Start: 15/12/2009 10:19:01
 End: 28/01/2010 11:14:59

Date/time Value Quality Flag Flag 1

Parameter: Water Level Groundwater
 Data Type: Unspecified Instantaneous
 Units: mAOD
 Start: 28/01/2010 11:15:00
 End: 28/01/2010 11:15:00

Date/time Value Quality Flag Flag 1
 28/01/2010 11:15:00 87.14 Good 1

Parameter: Water Level Groundwater
 Data Type: Unspecified Instantaneous
 Units: mAOD
 Start: 28/01/2010 11:15:01
 End: 03/03/2010 14:06:59

Date/time Value Quality Flag Flag 1

From To Comment
 23/02/2010 14:45:00 23/02/2010 14:45:00 Dip of 20.760m removed as spurious data.

Parameter: Water Level Groundwater
 Data Type: Unspecified Instantaneous
 Units: mAOD
 Start: 03/03/2010 14:07:00
 End: 30/03/2016 00:00:00

Date/time Value Quality Flag Flag 1

03/03/2010 14:07:00	87.16 Good	1
29/03/2010 14:55:00	86.97 Good	1
30/04/2010 10:15:00	86.61 Good	1
24/05/2010 13:31:00	85.99 Good	1
23/06/2010 12:48:00	85 Good	1
27/07/2010 14:45:00	83.97 Good	1
26/08/2010 13:35:00	83.64 Good	1
01/10/2010 13:48:00	83.35 Good	1
29/10/2010 13:46:00	83.58 Good	1
01/12/2010 13:55:00	84.19 Good	1
21/12/2010 14:40:00	84.3 Good	1
27/01/2011 14:25:00	85.41 Good	1
25/02/2011 14:25:00	85.5 Good	1
30/03/2011 09:50:00	85.28 Good	1
26/04/2011 14:10:00	84.74 Good	1
31/05/2011 14:04:00	83.93 Good	1
27/06/2011 14:35:00	83.51 Good	1
04/08/2011 13:35:00	82.82 Good	1
30/08/2011 16:00:00	82.42 Good	1
27/09/2011 13:20:00	82.25 Good	1
28/10/2011 15:05:00	81.86 Good	1
28/11/2011 14:45:00	82.46 Good	1
22/12/2011 15:50:00	83.23 Good	1
27/01/2012 15:05:00	84.22 Good	1
27/02/2012 11:30:00	84.17 Good	1
27/03/2012 13:24:00	84.01 Good	1
27/04/2012 13:20:00	84.02 Good	1
31/05/2012 11:34:00	84.86 Good	1
28/06/2012 14:50:00	84.87 Good	1
31/07/2012 15:50:00	84.69 Good	1
28/08/2012 09:36:00	84.45 Good	1
28/09/2012 13:00:00	84.1 Good	1
24/10/2012 14:20:00	84.74 Good	1
26/11/2012 13:10:00	84.86 Good	1
20/12/2012 13:45:00	86.5 Good	1
29/01/2013 13:50:00	87.135 Good	1
28/02/2013 15:20:00	87.07 Good	1
25/03/2013 13:50:00	86.96 Good	1
19/04/2013 13:20:00	86.83 Good	1
21/05/2013 12:05:00	86.2 Good	1
18/06/2013 13:40:00	85.41 Good	1
26/07/2013 13:12:00	84.25 Good	1
20/08/2013 08:40:00	83.75 Good	1
25/10/2013 11:00:00	83.43 Good	1
27/01/2014 14:53:00	88.01 Good	1
24/02/2014 15:50:00	88.12 Good	1
06/03/2014 14:21:00	88.03 Good	1
27/03/2014 15:59:00	87.64 Good	1
24/04/2014 14:13:00	86.84 Good	1

22/05/2014 13:41:00	86.38 Good	1
30/06/2014 13:50:00	85.42 Good	1
28/07/2014 13:05:00	84.69 Good	1
27/08/2014 13:33:00	84.24 Good	1
26/09/2014 12:35:00	83.89 Good	1
28/11/2014 14:40:00	85.15 Good	1
19/12/2014 14:03:00	85.82 Good	1
26/01/2015 14:15:00	86.26 Good	1
27/02/2015 10:10:00	86.14 Good	1
31/03/2015 14:12:00	85.84 Good	1
24/04/2015 14:00:00	85.29 Good	1
26/05/2015 13:55:00	86.69 Good	1
29/06/2015 14:00:00	83.96 Good	1
27/07/2015 14:50:00	83.65 Good	1
25/08/2015 09:21:00	83.32 Good	1
30/09/2015 14:49:00	84.12 Good	1
26/10/2015 13:24:00	84.09 Good	1
30/11/2015 13:06:00	84.21 Good	1
22/12/2015 13:05:00	84.4 Good	1
29/01/2016 11:10:00	86.11 Good	1
26/02/2016 14:39:00	86.63 Good	1
29/03/2016 09:15:00	86.45 Good	1

Station ID SU74/8
 Name ERLANDS HOUSE
 NGR SU79354988
 Region EA South East
 No. Datasets 3
 Last Row 752

Parameter: Water Level Groundwater
 Data Type: Unspecified Instantaneous
 Units: mAOD
 Start: 02/01/1950 00:00:00
 End: 23/02/2010 16:11:00

Date/time	Value	Quality	Flag	Flag 1
02/01/1950 12:00:00	89.4	Good		1
01/03/1950 12:00:00	89.27	Good		1
04/04/1950 12:00:00	89.17	Good		1
02/05/1950 12:00:00	89.4	Good		1
13/06/1950 12:00:00	88.28	Good		1
11/07/1950 12:00:00	87.75	Good		1
09/08/1950 12:00:00	87.06	Good		1
20/09/1950 12:00:00	88.28	Good		1
17/10/1950 12:00:00	87.01	Good		1
12/02/1951 12:00:00	90.21	Good		1
06/03/1951 12:00:00	89.96	Good		1
04/04/1951 12:00:00	90.01	Good		1
04/05/1951 12:00:00	90.11	Good		1
06/06/1951 12:00:00	89.67	Good		1
20/07/1951 12:00:00	88.3	Good		1
01/08/1951 12:00:00	88.2	Good		1
05/09/1951 12:00:00	88.84	Good		1
05/10/1951 12:00:00	88.58	Good		1
02/11/1951 12:00:00	87.49	Good		1
04/12/1951 12:00:00	89.55	Good		1
01/01/1952 12:00:00	90.34	Good		1
04/02/1952 12:00:00	90.01	Good		1
06/03/1952 12:00:00	89.07	Good		1
07/04/1952 12:00:00	89.96	Good		1
06/05/1952 12:00:00	90.51	Good		1
10/06/1952 12:00:00	89.22	Good		1
09/07/1952 12:00:00	88.2	Good		1
01/08/1952 12:00:00	87.36	Good		1
09/09/1952 12:00:00	87.04	Good		1
10/10/1952 12:00:00	87.24	Good		1
10/11/1952 12:00:00	86.98	Good		1
12/12/1952 12:00:00	89.07	Good		1
06/01/1953 12:00:00	89.96	Good		1
07/02/1953 12:00:00	89.93	Good		1
07/03/1953 12:00:00	89.5	Good		1

04/04/1953 12:00:00	89.37 Good	1
20/05/1953 12:00:00	90.26 Good	1
18/06/1953 12:00:00	88.88 Good	1
10/07/1953 12:00:00	87.36 Good	1
18/08/1953 12:00:00	86.86 Good	1
03/09/1953 12:00:00	86.75 Good	1
20/10/1953 12:00:00	86.73 Good	1
20/11/1953 12:00:00	86.93 Good	1
07/01/1954 12:00:00	87.11 Good	1
08/02/1954 12:00:00	89.07 Good	1
11/03/1954 12:00:00	89.65 Good	1
11/05/1954 12:00:00	88.79 Good	1
07/07/1954 12:00:00	88.28 Good	1
03/09/1954 12:00:00	87.29 Good	1
05/10/1954 12:00:00	87.08 Good	1
17/11/1954 12:00:00	88.68 Good	1
09/12/1954 12:00:00	90.69 Good	1
11/01/1955 12:00:00	90.21 Good	1
09/03/1955 12:00:00	89.6 Good	1
19/04/1955 12:00:00	89.07 Good	1
18/05/1955 12:00:00	89.93 Good	1
13/07/1955 12:00:00	87.92 Good	1
29/08/1955 12:00:00	86.75 Good	1
13/12/1955 12:00:00	88.25 Good	1
30/01/1956 12:00:00	90.08 Good	1
28/02/1956 12:00:00	89.22 Good	1
06/04/1956 12:00:00	88.71 Good	1
07/05/1956 12:00:00	88.25 Good	1
02/07/1956 12:00:00	87.42 Good	1
10/09/1956 12:00:00	90.56 Good	1
13/11/1956 12:00:00	87.8 Good	1
14/01/1957 12:00:00	89.96 Good	1
14/02/1957 12:00:00	90.01 Good	1
09/04/1957 12:00:00	89.67 Good	1
28/05/1957 12:00:00	88.1 Good	1
10/07/1957 12:00:00	87.92 Good	1
19/09/1957 12:00:00	86.83 Good	1
11/11/1957 12:00:00	89.19 Good	1
30/12/1957 12:00:00	88.2 Good	1
03/03/1958 12:00:00	90.18 Good	1
28/04/1958 12:00:00	90.01 Good	1
04/06/1958 12:00:00	90.08 Good	1
01/07/1958 12:00:00	90.18 Good	1
07/08/1958 12:00:00	88.46 Good	1
04/09/1958 12:00:00	89.88 Good	1
01/10/1958 12:00:00	90.41 Good	1
06/11/1958 12:00:00	90.51 Good	1
16/12/1958 12:00:00	90.39 Good	1
09/02/1959 12:00:00	89.96 Good	1

17/03/1959 12:00:00	90.13 Good	1
20/04/1959 12:00:00	90.13 Good	1
19/05/1959 12:00:00	89.63 Good	1
21/07/1959 12:00:00	88.13 Good	1
25/08/1959 12:00:00	87.62 Good	1
22/09/1959 12:00:00	86.53 Good	1
26/10/1959 12:00:00	86.53 Good	1
24/11/1959 12:00:00	88.53 Good	1
21/12/1959 12:00:00	90.18 Good	1
20/01/1960 12:00:00	90.16 Good	1
16/02/1960 12:00:00	90.13 Good	1
24/03/1960 12:00:00	89.7 Good	1
13/04/1960 12:00:00	89.88 Good	1
17/05/1960 12:00:00	89.73 Good	1
15/06/1960 12:00:00	88.66 Good	1
20/07/1960 12:00:00	88.74 Good	1
29/08/1960 12:00:00	88.41 Good	1
21/09/1960 12:00:00	88.93 Good	1
18/10/1960 12:00:00	89.37 Good	1
08/11/1960 12:00:00	90.06 Good	1
07/12/1960 12:00:00	90.44 Good	1
05/01/1961 12:00:00	90.21 Good	1
08/02/1961 12:00:00	90.16 Good	1
03/03/1961 12:00:00	90.16 Good	1
11/04/1961 12:00:00	90.24 Good	1
09/05/1961 12:00:00	90.06 Good	1
12/06/1961 12:00:00	89.07 Good	1
17/07/1961 12:00:00	88.67 Good	1
22/08/1961 12:00:00	87.57 Good	1
18/09/1961 12:00:00	88.61 Good	1
15/10/1961 12:00:00	89.09 Good	1
15/11/1961 12:00:00	89.96 Good	1
06/02/1962 12:00:00	90.11 Good	1
01/03/1962 12:00:00	89.57 Good	1
02/04/1962 12:00:00	89.65 Good	1
01/05/1962 12:00:00	89.75 Good	1
01/06/1962 12:00:00	89.37 Good	1
03/07/1962 12:00:00	88.05 Good	1
01/08/1962 12:00:00	87.57 Good	1
03/09/1962 12:00:00	87.52 Good	1
02/10/1962 12:00:00	89.88 Good	1
02/11/1962 12:00:00	89.19 Good	1
03/12/1962 12:00:00	89.02 Good	1
01/02/1963 12:00:00	89.09 Good	1
01/03/1963 12:00:00	89.52 Good	1
01/04/1963 12:00:00	90.16 Good	1
01/05/1963 12:00:00	90.28 Good	1
03/06/1963 12:00:00	89.65 Good	1
29/07/1963 12:00:00	87.8 Good	1

27/08/1963 12:00:00	88.51 Good	1
25/09/1963 12:00:00	88.25 Good	1
24/10/1963 12:00:00	88.18 Good	1
29/11/1963 12:00:00	90.62 Good	1
20/02/1964 12:00:00	89.8 Good	1
17/03/1964 12:00:00	90.62 Good	1
15/04/1964 12:00:00	90.03 Good	1
01/05/1964 12:00:00	90.28 Good	1
01/06/1964 12:00:00	90.49 Good	1
01/07/1964 12:00:00	89.78 Good	1
14/08/1964 12:00:00	87.9 Good	1
15/09/1964 12:00:00	87.06 Good	1
16/10/1964 12:00:00	86.78 Good	1
16/11/1964 12:00:00	87.19 Good	1
16/12/1964 12:00:00	88.53 Good	1
15/01/1965 12:00:00	90.16 Good	1
16/02/1965 12:00:00	88.23 Good	1
16/03/1965 12:00:00	89.65 Good	1
15/04/1965 12:00:00	89.02 Good	1
19/05/1965 12:00:00	88.13 Good	1
15/06/1965 12:00:00	87.75 Good	1
16/07/1965 12:00:00	88.18 Good	1
12/08/1965 12:00:00	88.18 Good	1
15/09/1965 12:00:00	89.65 Good	1
15/10/1965 12:00:00	89.37 Good	1
15/11/1965 12:00:00	89.55 Good	1
16/12/1965 12:00:00	90.41 Good	1
17/01/1966 12:00:00	89.75 Good	1
15/02/1966 12:00:00	90.34 Good	1
15/03/1966 12:00:00	90.03 Good	1
15/04/1966 12:00:00	90.16 Good	1
16/05/1966 12:00:00	90.28 Good	1
15/06/1966 12:00:00	89.32 Good	1
15/07/1966 12:00:00	89.35 Good	1
16/08/1966 12:00:00	89.57 Good	1
17/09/1966 12:00:00	89.09 Good	1
14/10/1966 12:00:00	90.39 Good	1
15/11/1966 12:00:00	89.83 Good	1
16/12/1966 12:00:00	90.13 Good	1
17/01/1967 12:00:00	90.01 Good	1
20/02/1967 12:00:00	90.62 Good	1
14/03/1967 12:00:00	90.49 Good	1
14/04/1967 12:00:00	90.36 Good	1
15/05/1967 12:00:00	90.67 Good	1
15/06/1967 12:00:00	89.96 Good	1
15/07/1967 12:00:00	89.22 Good	1
15/08/1967 12:00:00	88.89 Good	1
15/09/1967 12:00:00	88.33 Good	1
14/10/1967 12:00:00	89.63 Good	1

15/11/1967 12:00:00	90.06 Good	1
15/12/1967 12:00:00	90.18 Good	1
15/01/1968 12:00:00	90.51 Good	1
15/02/1968 12:00:00	90.28 Good	1
15/03/1968 12:00:00	89.93 Good	1
16/04/1968 12:00:00	89.83 Good	1
14/05/1968 12:00:00	90.24 Good	1
15/06/1968 12:00:00	89.65 Good	1
15/07/1968 12:00:00	90.28 Good	1
15/08/1968 12:00:00	89.98 Good	1
16/09/1968 12:00:00	90.62 Good	1
15/10/1968 12:00:00	90.24 Good	1
15/11/1968 12:00:00	90.26 Good	1
16/12/1968 12:00:00	90.62 Good	1
15/01/1969 12:00:00	90.62 Good	1
20/02/1969 12:00:00	90.39 Good	1
15/03/1969 12:00:00	90.56 Good	1
16/04/1969 12:00:00	90.11 Good	1
14/05/1969 12:00:00	89.85 Good	1
16/06/1969 12:00:00	89.57 Good	1
16/07/1969 12:00:00	89.24 Good	1
18/08/1969 12:00:00	88.99 Good	1
18/09/1969 12:00:00	88.05 Good	1
15/10/1969 12:00:00	87.46 Good	1
13/11/1969 12:00:00	90.54 Good	1
15/12/1969 12:00:00	90.62 Good	1
16/01/1970 12:00:00	90.74 Good	1
16/02/1970 12:00:00	90.39 Good	1
15/03/1970 12:00:00	90.39 Good	1
16/04/1970 12:00:00	90.39 Good	1
15/05/1970 12:00:00	90.18 Good	1
15/06/1970 12:00:00	89.42 Good	1
15/07/1970 12:00:00	89.02 Good	1
13/08/1970 12:00:00	88.43 Good	1
10/09/1970 12:00:00	87.65 Good	1
14/10/1970 12:00:00	87.39 Good	1
16/11/1970 12:00:00	89.18 Good	1
15/12/1970 12:00:00	89.27 Good	1
20/01/1971 12:00:00	90.34 Good	1
15/02/1971 12:00:00	90.31 Good	1
16/03/1971 12:00:00	90.24 Good	1
19/04/1971 12:00:00	89.88 Good	1
17/05/1971 12:00:00	89.98 Good	1
15/06/1971 12:00:00	90.44 Good	1
17/07/1971 12:00:00	88.66 Good	1
18/08/1971 12:00:00	88.76 Good	1
15/09/1971 12:00:00	87.67 Good	1
16/10/1971 12:00:00	88.28 Good	1
15/11/1971 12:00:00	88.23 Good	1

16/12/1971 12:00:00	88.76 Good	1
15/01/1972 12:00:00	90.03 Good	1
22/02/1972 12:00:00	90.03 Good	1
16/03/1972 12:00:00	90.03 Good	1
17/04/1972 12:00:00	90.01 Good	1
15/05/1972 12:00:00	90.03 Good	1
15/06/1972 12:00:00	89.65 Good	1
14/07/1972 12:00:00	88.91 Good	1
18/08/1972 12:00:00	88.43 Good	1
19/09/1972 12:00:00	88.58 Good	1
17/10/1972 12:00:00	88.91 Good	1
18/11/1972 12:00:00	88.58 Good	1
18/12/1972 12:00:00	90.03 Good	1
16/01/1973 12:00:00	89.8 Good	1
17/02/1973 12:00:00	89.73 Good	1
14/03/1973 12:00:00	89.19 Good	1
17/04/1973 12:00:00	89.22 Good	1
15/05/1973 12:00:00	89.88 Good	1
20/06/1973 12:00:00	90.21 Good	1
18/07/1973 12:00:00	90.44 Good	1
15/08/1973 12:00:00	89.7 Good	1
18/09/1973 12:00:00	89.24 Good	1
16/10/1973 12:00:00	89.4 Good	1
13/11/1973 12:00:00	89.4 Good	1
17/12/1973 12:00:00	89.8 Good	1
15/01/1974 12:00:00	90.56 Good	1
13/02/1974 12:00:00	90.56 Good	1
13/03/1974 12:00:00	90.46 Good	1
17/04/1974 12:00:00	89.85 Good	1
15/05/1974 12:00:00	89.5 Good	1
18/06/1974 12:00:00	89.04 Good	1
23/07/1974 12:00:00	89.12 Good	1
28/08/1974 12:00:00	88.96 Good	1
17/09/1974 12:00:00	89.63 Good	1
15/10/1974 12:00:00	90.34 Good	1
19/11/1974 12:00:00	90.64 Good	1
28/12/1974 12:00:00	90.06 Good	1
14/01/1975 12:00:00	90.56 Good	1
18/02/1975 12:00:00	90.41 Good	1
23/03/1975 12:00:00	90.56 Good	1
23/04/1975 12:00:00	90.49 Good	1
21/05/1975 12:00:00	90.34 Good	1
18/06/1975 12:00:00	89.57 Good	1
15/07/1975 12:00:00	89.02 Good	1
06/08/1975 12:00:00	88.66 Good	1
16/09/1975 12:00:00	89.27 Good	1
14/10/1975 12:00:00	89.12 Good	1
19/11/1975 12:00:00	90.26 Good	1
17/12/1975 12:00:00	89.69 Good	1

17/01/1976 12:00:00	89.78 Good	1
14/02/1976 12:00:00	90.18 Good	1
15/03/1976 12:00:00	89.35 Good	1
14/04/1976 12:00:00	89.06 Good	1
17/05/1976 12:00:00	88.63 Good	1
15/06/1976 12:00:00	88.2 Good	1
13/07/1976 12:00:00	87.85 Good	1
15/08/1976 12:00:00	87.11 Good	1
16/11/1976 12:00:00	90.34 Good	1
14/12/1976 12:00:00	89.88 Good	1
18/01/1977 12:00:00	90.21 Good	1
15/02/1977 12:00:00	90.28 Good	1
15/03/1977 12:00:00	90.64 Good	1
16/05/1977 12:00:00	90.21 Good	1
14/06/1977 12:00:00	90.03 Good	1
25/07/1977 12:00:00	88.68 Good	1
15/08/1977 12:00:00	88.48 Good	1
13/09/1977 12:00:00	88.63 Good	1
17/10/1977 12:00:00	88.76 Good	1
15/11/1977 12:00:00	88.13 Good	1
19/12/1977 12:00:00	90.24 Good	1
16/01/1978 12:00:00	90.08 Good	1
13/02/1978 12:00:00	88.25 Good	1
14/03/1978 12:00:00	90.46 Good	1
17/04/1978 12:00:00	90.08 Good	1
16/05/1978 12:00:00	90.16 Good	1
13/06/1978 12:00:00	89.98 Good	1
17/07/1978 12:00:00	89.04 Good	1
15/08/1978 12:00:00	89.78 Good	1
18/09/1978 12:00:00	88.94 Good	1
17/10/1978 12:00:00	88.66 Good	1
14/11/1978 12:00:00	87.24 Good	1
18/12/1978 12:00:00	89.9 Good	1
16/01/1979 12:00:00	89.83 Good	1
27/02/1979 12:00:00	90.01 Good	1
15/03/1979 12:00:00	90.31 Good	1
17/04/1979 12:00:00	90.24 Good	1
16/06/1979 12:00:00	90.21 Good	1
16/07/1979 12:00:00	89.37 Good	1
13/08/1979 12:00:00	89.42 Good	1
17/09/1979 12:00:00	88.07 Good	1
16/10/1979 12:00:00	88.64 Good	1
13/11/1979 12:00:00	88.56 Good	1
18/12/1979 12:00:00	90.28 Good	1
15/01/1980 12:00:00	89.73 Good	1
18/02/1980 12:00:00	89.93 Good	1
17/03/1980 12:00:00	90.08 Good	1
15/04/1980 12:00:00	90.44 Good	1
13/05/1980 12:00:00	89.65 Good	1

16/06/1980 12:00:00	89.17 Good	1
24/07/1980 12:00:00	89.24 Good	1
13/08/1980 12:00:00	89.45 Good	1
16/09/1980 12:00:00	87.8 Good	1
15/10/1980 12:00:00	90.05 Good	1
17/11/1980 12:00:00	89.8 Good	1
14/12/1980 12:00:00	89.59 Good	1
20/01/1981 12:00:00	90.35 Good	1
16/02/1981 12:00:00	89.77 Good	1
19/03/1981 12:00:00	91.17 Good	1
16/04/1981 12:00:00	90.05 Good	1
15/05/1981 12:00:00	90.09 Good	1
15/06/1981 12:00:00	90.05 Good	1
15/07/1981 12:00:00	89.05 Good	1
18/08/1981 12:00:00	89.15 Good	1
16/09/1981 12:00:00	88.1 Good	1
19/10/1981 12:00:00	90 Good	1
16/11/1981 12:00:00	89.61 Good	1
21/01/1982 12:00:00	90.23 Good	1
15/02/1982 12:00:00	90.14 Good	1
17/03/1982 12:00:00	90.5 Good	1
15/04/1982 12:00:00	90.05 Good	1
18/05/1982 12:00:00	89.65 Good	1
16/06/1982 12:00:00	89.45 Good	1
14/07/1982 12:00:00	89.35 Good	1
14/08/1982 12:00:00	88.25 Good	1
17/09/1982 12:00:00	87.43 Good	1
19/10/1982 12:00:00	89.71 Good	1
18/11/1982 12:00:00	90.45 Good	1
15/12/1982 12:00:00	90.33 Good	1
17/01/1983 12:00:00	90.36 Good	1
17/03/1983 12:00:00	90.09 Good	1
15/05/1983 12:00:00	90.31 Good	1
14/06/1983 12:00:00	90.05 Good	1
15/07/1983 12:00:00	89.95 Good	1
18/08/1983 12:00:00	88.88 Good	1
16/09/1983 12:00:00	88.4 Good	1
14/10/1983 12:00:00	89.05 Good	1
16/11/1983 12:00:00	87.61 Good	1
16/12/1983 12:00:00	89.84 Good	1
12/01/1984 12:00:00	89.17 Good	1
16/02/1984 12:00:00	90.05 Good	1
15/03/1984 12:00:00	90.15 Good	1
14/04/1984 12:00:00	90 Good	1
15/05/1984 12:00:00	89.55 Good	1
14/06/1984 12:00:00	89.78 Good	1
14/07/1984 12:00:00	89.4 Good	1
15/08/1984 12:00:00	89.11 Good	1
14/09/1984 12:00:00	90.1 Good	1

13/10/1984 12:00:00	89.85 Good	1
14/11/1984 12:00:00	90.23 Good	1
14/12/1984 12:00:00	90.05 Good	1
14/01/1985 12:00:00	89.73 Good	1
21/02/1985 12:00:00	90.23 Good	1
15/03/1985 12:00:00	90.16 Good	1
17/04/1985 12:00:00	90.25 Good	1
14/06/1985 12:00:00	89.85 Good	1
12/07/1985 12:00:00	89.95 Good	1
13/08/1985 12:00:00	89.9 Good	1
17/09/1985 12:00:00	88.55 Good	1
15/10/1985 12:00:00	88.15 Good	1
13/11/1985 12:00:00	88.44 Good	1
14/12/1985 12:00:00	90.12 Good	1
15/01/1986 12:00:00	90.05 Good	1
14/02/1986 12:00:00	90.19 Good	1
14/03/1986 12:00:00	90.15 Good	1
16/04/1986 12:00:00	90.45 Good	1
15/05/1986 12:00:00	90.2 Good	1
13/06/1986 12:00:00	89.7 Good	1
16/07/1986 12:00:00	89.3 Good	1
14/08/1986 12:00:00	89.28 Good	1
16/09/1986 12:00:00	89.32 Good	1
17/10/1986 12:00:00	88.52 Good	1
13/11/1986 12:00:00	90.11 Good	1
13/12/1986 12:00:00	90.58 Good	1
29/01/1987 12:00:00	90.1 Good	1
23/02/1987 12:00:00	90.31 Good	1
13/03/1987 12:00:00	90.27 Good	1
15/04/1987 12:00:00	89.85 Good	1
15/05/1987 12:00:00	89.91 Good	1
17/06/1987 12:00:00	89.55 Good	1
15/07/1987 12:00:00	89 Good	1
15/08/1987 12:00:00	88.55 Good	1
15/09/1987 12:00:00	89.75 Good	1
24/10/1987 12:00:00	90.04 Good	1
15/11/1987 12:00:00	90.45 Good	1
15/12/1987 12:00:00	89.71 Good	1
13/01/1988 12:00:00	90.47 Good	1
13/02/1988 12:00:00	90.42 Good	1
15/03/1988 12:00:00	90.25 Good	1
15/04/1988 12:00:00	90.4 Good	1
16/05/1988 12:00:00	89.93 Good	1
11/06/1988 12:00:00	89.48 Good	1
15/07/1988 12:00:00	89.81 Good	1
15/08/1988 12:00:00	89.8 Good	1
14/09/1988 12:00:00	89.81 Good	1
15/10/1988 12:00:00	89.96 Good	1
15/11/1988 12:00:00	89.89 Good	1

16/12/1988 12:00:00	89.79 Good	1
13/01/1989 12:00:00	89.73 Good	1
17/02/1989 12:00:00	90.51 Good	1
17/03/1989 12:00:00	90.54 Good	1
19/05/1989 12:00:00	89.75 Good	1
16/06/1989 12:00:00	89.71 Good	1
15/07/1989 12:00:00	89.47 Good	1
15/08/1989 12:00:00	89.16 Good	1
16/09/1989 12:00:00	88.75 Good	1
15/10/1989 12:00:00	87.35 Good	1
17/11/1989 12:00:00	89.23 Good	1
19/12/1989 12:00:00	90.43 Good	1
15/01/1990 12:00:00	90.09 Good	1
15/02/1990 12:00:00	90.52 Good	1
15/03/1990 12:00:00	90.1 Good	1
18/04/1990 12:00:00	89.55 Good	1
15/05/1990 12:00:00	89.57 Good	1
26/06/1990 12:00:00	88.15 Good	1
20/07/1990 12:00:00	87.39 Good	1
16/08/1990 12:00:00	87 Good	1
26/09/1990 12:00:00	86.03 Good	1
16/10/1990 12:00:00	86.04 Good	1
16/11/1990 12:00:00	86.31 Good	1
11/12/1990 12:00:00	87.16 Good	1
10/01/1991 12:00:00	88.08 Good	1
13/02/1991 12:00:00	88.85 Good	1
20/03/1991 12:00:00	90.25 Good	1
15/04/1991 12:00:00	89.63 Good	1
20/05/1991 12:00:00	89.07 Good	1
12/06/1991 12:00:00	88.8 Good	1
17/07/1991 12:00:00	88.43 Good	1
09/08/1991 12:00:00	88.33 Good	1
12/09/1991 12:00:00	86.37 Good	1
17/10/1991 12:00:00	86.14 Good	1
22/11/1991 12:00:00	85.8 Good	1
17/12/1991 12:00:00	87.1 Good	1
17/01/1992 12:00:00	87.2 Good	1
19/02/1992 12:00:00	88.65 Good	1
13/03/1992 12:00:00	87.81 Good	1
14/04/1992 12:00:00	87.75 Good	1
18/05/1992 12:00:00	87.17 Good	1
17/06/1992 12:00:00	85.79 Good	1
13/07/1992 12:00:00	85.47 Good	1
19/08/1992 12:00:00	85.9 Good	1
17/09/1992 12:00:00	85.55 Good	1
20/10/1992 12:00:00	87.97 Good	1
17/11/1992 12:00:00	90.21 Good	1
15/12/1992 12:00:00	89.25 Good	1
14/01/1993 12:00:00	90.1 Good	1

26/02/1993 12:00:00	88.95 Good	1
16/03/1993 12:00:00	89.65 Good	1
16/04/1993 12:00:00	89.82 Good	1
17/05/1993 12:00:00	88.9 Good	1
16/06/1993 12:00:00	89.2 Good	1
19/07/1993 12:00:00	87.65 Good	1
16/08/1993 12:00:00	88.15 Good	1
09/09/1993 12:00:00	87.16 Good	1
12/10/1993 12:00:00	87.37 Good	1
11/11/1993 12:00:00	88.18 Good	1
14/12/1993 12:00:00	89.8 Good	1
14/01/1994 12:00:00	90.25 Good	1
14/02/1994 12:00:00	90.2 Good	1
14/03/1994 12:00:00	89.5 Good	1
19/04/1994 12:00:00	90 Good	1
01/07/1994 12:00:00	88.9 Good	1
26/08/1994 12:00:00	87.1 Good	1
09/09/1994 12:00:00	86.2 Good	1
12/10/1994 12:00:00	85.79 Good	1
15/11/1994 12:00:00	86.7 Good	1
23/12/1994 12:00:00	87.82 Good	1
16/01/1995 12:00:00	89.5 Good	1
22/02/1995 12:00:00	90.15 Good	1
02/04/1995 12:00:00	89.87 Good	1
19/05/1995 12:00:00	87.68 Good	1
15/06/1995 12:00:00	87.05 Good	1
03/07/1995 12:00:00	86.55 Good	1
22/08/1995 12:00:00	85.3 Good	1
22/09/1995 12:00:00	85.6 Good	1
30/10/1995 12:00:00	85.85 Good	1
11/01/1996 12:00:00	89.95 Good	1
15/03/1996 12:00:00	88.41 Good	1
15/05/1996 12:00:00	87.43 Good	1
18/06/1996 12:00:00	86.6 Good	1
22/07/1996 12:00:00	86.5 Good	1
19/08/1996 12:00:00	87.3 Good	1
15/10/1996 12:00:00	86.47 Good	1
21/11/1996 12:00:00	90.15 Good	1
20/12/1996 12:00:00	90.25 Good	1
13/01/1997 12:00:00	86.83 Good	1
20/02/1997 12:00:00	90.35 Good	1
09/12/1997 12:00:00	90.1 Good	1
27/01/1998 12:00:00	89.7 Good	1
24/02/1998 12:00:00	88.43 Good	1
31/03/1998 12:00:00	89.2 Good	1
21/04/1998 12:00:00	90.15 Good	1
15/05/1998 12:00:00	89.35 Good	1
11/06/1998 12:00:00	89.17 Good	1
13/08/1998 12:00:00	87.65 Good	1

01/02/1999 10:03:00	90.03 Good	1
26/02/1999 09:06:00	89.83 Good	1
30/03/1999 09:21:00	89.75 Good	1
29/04/1999 09:35:00	89.98 Good	1
28/05/1999 09:06:00	89.8 Good	1
30/06/1999 09:58:00	89.62 Good	1
30/07/1999 12:36:00	88.18 Good	1
31/08/1999 09:51:00	88.69 Good	1
27/09/1999 08:41:00	90.24 Good	1
29/10/1999 08:58:00	89.88 Good	1
30/11/1999 09:30:00	90.2 Good	1
30/12/1999 10:07:00	90.05 Good	1
31/01/2000 12:00:00	89.63 Good	1
28/02/2000 12:00:00	90.19 Good	1
31/03/2000 13:40:00	89.72 Good	1
28/04/2000 08:15:00	90.1 Good	1
30/05/2000 08:08:00	90.12 Good	1
05/06/2000 13:03:00	89.95 Good	1
12/07/2000 12:30:00	89.91 Good	1
09/08/2000 12:25:00	89.05 Good	1
11/09/2000 11:30:00	88.4 Good	1
10/10/2000 12:10:00	90.44 Good	1
16/11/2000 12:27:00	90.59 Good	1
22/12/2000 10:00:00	90.24 Good	1
23/01/2001 13:27:00	90.51 Good	1
23/02/2001 11:10:00	90.17 Good	1
02/05/2001 12:25:00	90.26 Good	1
19/06/2001 09:42:00	89.83 Good	1
12/07/2001 12:36:00	89.71 Good	1
15/08/2001 12:15:00	89.4 Good	1
07/09/2001 12:00:00	88.94 Good	1
09/10/2001 12:05:00	90.23 Good	1
15/11/2001 12:35:00	89.68 Good	1
10/12/2001 13:20:00	89.95 Good	1
16/01/2002 13:18:00	89.96 Good	1
13/02/2002 13:56:00	90.1 Good	1
08/03/2002 12:51:00	90 Good	1
11/04/2002 12:10:00	89.85 Good	1
03/05/2002 12:25:00	89.99 Good	1
14/06/2002 13:23:00	90.1 Good	1
08/07/2002 12:52:00	89.94 Good	1
09/08/2002 09:26:00	90.16 Good	1
12/09/2002 12:14:00	89.29 Good	1
18/10/2002 14:00:00	89.59 Good	1
18/11/2002 14:12:00	90.13 Good	1
16/12/2002 12:50:00	90.19 Good	1
24/01/2003 14:20:00	90.07 Good	1
20/02/2003 14:05:00	90.02 Good	1
31/03/2003 12:00:00	89.84 Good	1

17/04/2003 09:05:00	89.71 Good	1
15/05/2003 12:00:00	89.63 Good	1
19/06/2003 09:10:00	89.2 Good	1
18/07/2003 09:30:00	88.65 Good	1
20/08/2003 12:00:00	87.47 Good	1
24/09/2003 12:00:00	86.82 Good	1
29/10/2003 12:00:00	86.3 Good	1
29/11/2003 12:00:00	89.87 Good	1
19/12/2003 12:00:00	89.57 Good	1
27/01/2004 08:20:00	89.77 Good	1
23/02/2004 09:35:00	89.52 Good	1
26/03/2004 10:14:00	89.91 Good	1
30/04/2004 12:00:00	90.07 Good	1
25/05/2004 12:00:00	89.52 Good	1
21/06/2004 12:00:00	88.61 Good	1
23/07/2004 08:00:00	88.485 Good	1
24/08/2004 09:05:00	89.11 Good	1
30/09/2004 13:30:00	87.33 Good	1
27/10/2004 12:00:00	89.89 Good	1
12/11/2004 12:10:00	89.9 Good	1
15/12/2004 15:05:00	88.89 Good	1
06/01/2005 13:54:00	89.63 Good	1
10/02/2005 13:26:00	89.31 Good	1
01/03/2005 13:50:00	89.35 Good	1
10/04/2005 11:55:00	89.83 Good	1
04/05/2005 11:34:00	89.44 Good	1
08/06/2005 12:07:00	88.38 Good	1
08/07/2005 08:05:00	87.46 Good	1
05/08/2005 12:21:00	87.49 Good	1
07/09/2005 10:37:00	87.5 Good	1
06/10/2005 11:20:00	86.9 Good	1
02/11/2005 12:05:00	90.13 Good	1
02/12/2005 11:59:00	90.55 Good	1
13/01/2006 12:40:00	89.94 Good	1
03/02/2006 11:29:00	89.2 Good	1
03/03/2006 12:13:00	89.6 Good	1
20/04/2006 10:58:00	89.35 Good	1
26/05/2006 11:31:00	90.15 Good	1
29/06/2006 13:45:00	87.45 Good	1
20/07/2006 14:30:00	87.05 Good	1
10/08/2006 09:05:00	87.03 Good	1
19/09/2006 14:00:00	87.46 Good	1
10/10/2006 08:45:00	88.88 Good	1
08/11/2006 14:39:00	88.85 Good	1
13/12/2006 14:37:00	90.45 Good	1
09/01/2007 13:02:00	90.54 Good	1
14/02/2007 12:49:00	90.65 Good	1
13/03/2007 13:41:00	90.32 Good	1
27/04/2007 11:28:00	89.78 Good	1

31/05/2007 12:57:00	90.38	Good	1
18/06/2007 09:49:00	90.04	Good	1
11/07/2007 14:47:00	89.75	Good	1
23/08/2007 12:04:00	90.15	Good	1
20/09/2007 09:52:00	89.38	Good	1
25/10/2007 09:45:00	90.1	Good	1
28/11/2007 15:24:00	90.27	Good	1
28/12/2007 10:01:00	90.15	Good	1
21/01/2008 10:28:00	90.32	Good	1
28/02/2008 12:30:00	91.2	Good	1
27/03/2008 11:10:00	89.88	Good	1
18/04/2008 08:10:00	90.04	Good	1
20/05/2008 09:59:00	89.85	Good	1
24/06/2008 09:51:00	89.86	Good	1
22/07/2008 11:12:00	89.73	Good	1
27/08/2008 11:57:00	89.26	Good	1
18/09/2008 12:40:00	90.44	Good	1
16/10/2008 13:01:00	90.28	Good	1
14/11/2008 12:39:00	90.65	Good	1
16/12/2008 11:42:00	90.9	Good	1
07/01/2009 13:16:00	90.65	Good	1
12/02/2009 11:18:00	91.05	Good	1
12/03/2009 11:03:00	90.95	Good	1
28/04/2009 11:00:00	89.96	Good	1
28/05/2009 16:00:00	90.08	Good	1
26/06/2009 10:15:00	90.31	Good	1
22/07/2009 14:20:00	88.66	Good	1
20/08/2009 13:10:00	89.27	Good	1
22/09/2009 14:38:00	89.96	Good	1
15/10/2009 14:41:00	90.14	Good	1
01/12/2009 11:33:00	91.07	Good	1
14/12/2009 14:32:00	90.86	Good	1
27/01/2010 09:00:00	91.25	Good	1
28/01/2010 11:30:00	90.89	Good	1
23/02/2010 16:11:00	91.01	Good	1

From	To	Comment
		There are no values in the time range 02/01/1950 00:00:00 to 02/01/1950 11:59:00
02/01/1950 00:00:00	02/01/1950 11:59:00	

Parameter:	Water Level	Groundwater
Data Type:	Unspecified	Instantaneous
Units:	mAOD	
Start:	23/02/2010	16:11:01
End:	03/03/2010	14:14:59

Date/time	Value	Quality Flag	Flag 1
Parameter:	Water Level	Groundwater	
Data Type:	Unspecified	Instantaneous	
Units:	mAOD		
Start:	03/03/2010	14:15:00	
End:	30/03/2016	00:00:00	

Date/time	Value	Quality Flag	Flag 1
03/03/2010 14:15:00	90.84	Good	1
29/03/2010 15:10:00	90.95	Good	1
30/04/2010 10:05:00	90.89	Good	1
24/05/2010 13:40:00	90.89	Good	1
23/06/2010 12:59:00	90.83	Good	1
27/07/2010 14:50:00	90.76	Good	1
26/08/2010 13:43:00	90.73	Good	1
01/10/2010 14:05:00	90.72	Good	1
29/10/2010 13:55:00	90.66	Good	1
01/12/2010 14:08:00	90.43	Good	1
21/12/2010 14:50:00	90.59	Good	1
27/01/2011 14:12:00	90.56	Good	1
25/02/2011 14:10:00	90.89	Suspect	2
30/03/2011 10:05:00	90.52	Good	1
26/04/2011 14:03:00	90.45	Good	1
31/05/2011 14:12:00	90.05	Good	1
27/06/2011 14:25:00	90.84	Good	1
04/08/2011 13:25:00	90.2	Good	1
30/08/2011 15:50:00	91.09	Good	1
27/09/2011 13:45:00	90.5	Good	1
28/10/2011 14:50:00	90.49	Good	1
28/11/2011 14:35:00	91.06	Good	1
22/12/2011 15:45:00	91.13	Good	1
27/01/2012 14:55:00	90.97	Good	1
27/02/2012 11:40:00	90.94	Good	1
27/03/2012 13:11:00	90.92	Good	1
27/04/2012 13:55:00	91.14	Good	1
31/05/2012 11:25:00	91.05	Good	1
28/06/2012 14:40:00	91.06	Good	1
31/07/2012 15:40:00	90.97	Good	1
28/08/2012 09:47:00	91.055	Good	1
28/09/2012 12:40:00	91.14	Good	1
24/10/2012 14:05:00	91.16	Estimated	3
26/11/2012 12:55:00	91.19	Good	1
26/07/2013 13:10:00	91.01	Good	1
27/02/2015 09:45:00	90.61	Good	1
31/03/2015 14:04:00	90.54	Good	1
24/04/2015 14:50:00	90.47	Good	1

26/05/2015 13:40:00	90.43	Good	1
29/06/2015 13:51:00	90.64	Good	1
27/07/2015 14:27:00	90.56	Good	1
25/08/2015 09:28:00	90.6	Good	1
30/09/2015 14:41:00	90.64	Good	1
26/10/2015 13:11:00	90.6	Good	1
30/11/2015 13:18:00	90.56	Good	1
22/12/2015 13:55:00	90.7	Good	1
29/01/2016 11:00:00	90.68	Good	1
26/02/2016 14:32:00	90.69	Good	1
29/03/2016 09:22:00	90.71	Good	1

From	To	Comment
		Work has been undertaken on well top, needs to be relevelled and data adjusted accordingly
25/02/2011 14:10:00	25/02/2011 14:10:00	
31/05/2012 11:25:00	31/05/2012 11:25:00	new well head under construction work being carried out around well head
31/07/2012 15:40:00	31/07/2012 15:40:00	
24/10/2012 14:05:00	24/10/2012 14:05:00	Estimated values
26/11/2012 12:55:00	26/11/2012 12:55:00	Estimated values